
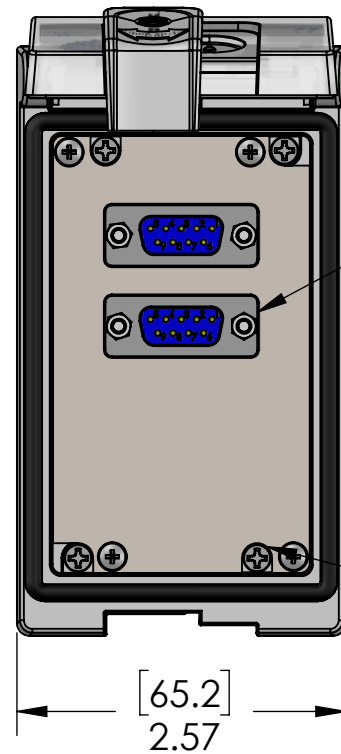


PANEL CUTOUT

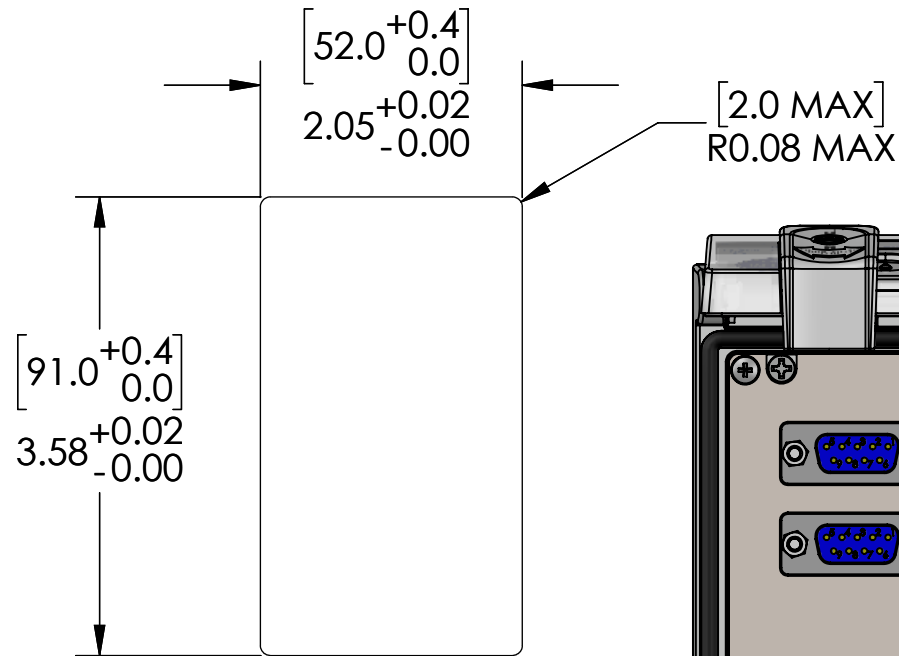


— (X2) D-SUB CONFIGURED
FEMALE EXTERIOR /
MALE INTERIOR


— (X4) USE PH2 SCREW DRIVER ON MOUNTING SCREWS. (REF. MOUNTING SCREW TORQUE)

ROTATE TWO TURNS COUNTER
CLOCKWISE TO RELEASE THE
TURN BUCKLE PRIOR TO TIGHTENING



TURN BUCKLES ROTATE 90 DEG. INTO
THEIR CLAMPING POSITION AS
MOUNTING SCREWS TIGHTEN.
DO NOT OVER-TORQUE!_____

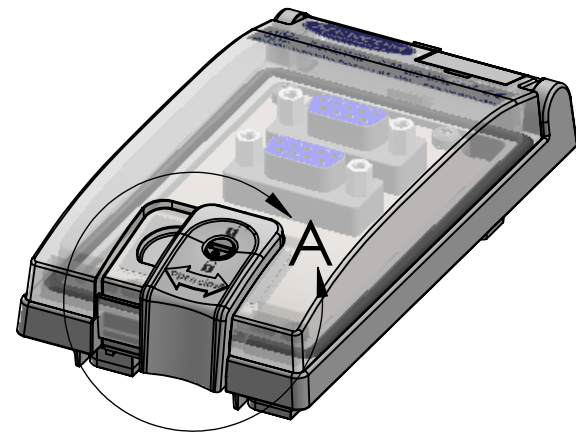

SLIDE LATCH TO OPEN/CLOSE
ROTATE LOCK TO LOCK CLOSED

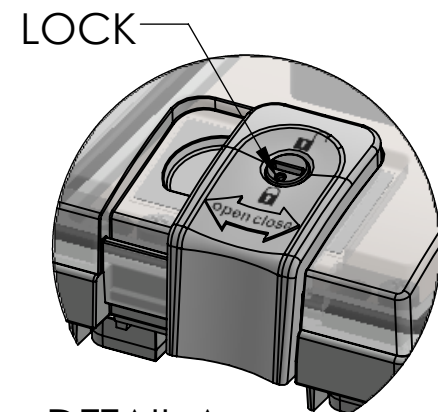

DETAIL A
SCALE 1 : 1

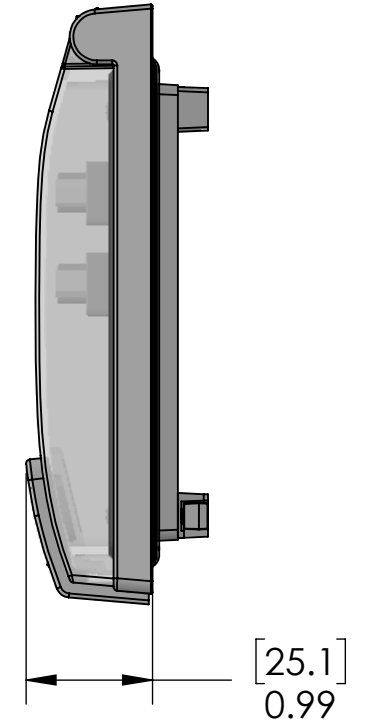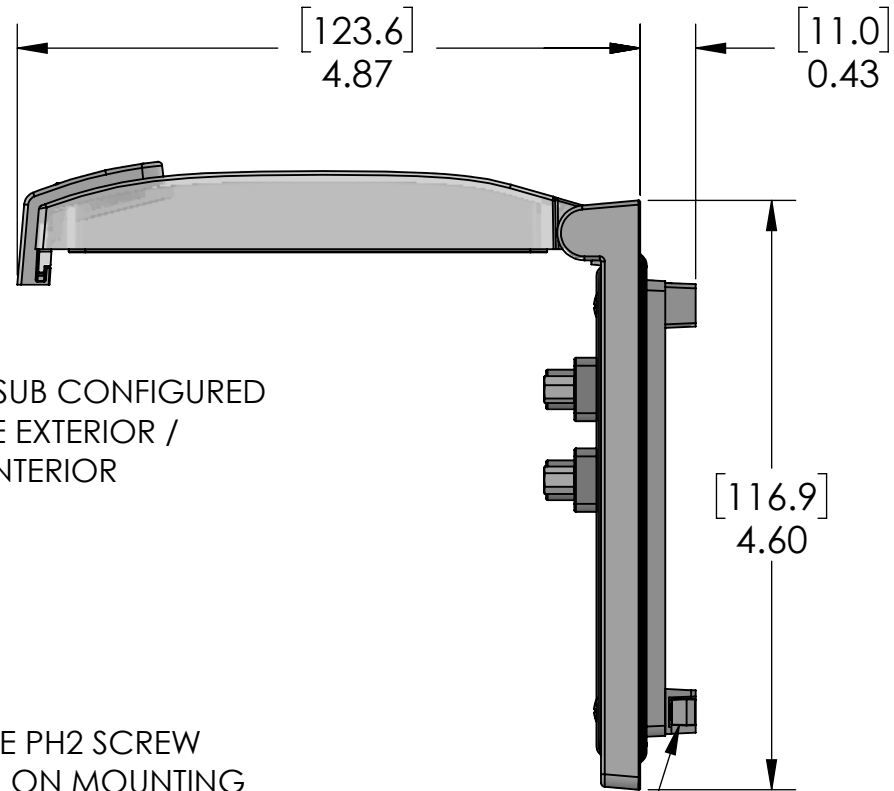

These devices shall be mounted on enclosures having adequate strength and thickness and with adequate spacing provided. Seal rating is based on mounting to a surface that is clean, flat and smooth.

US F)) ED:	PIC RATINGS/SPECIFICATIONS				
	NEMA/UL EN 60529:		4, 12 IP65		
	PANEL THICKNESS:		5.0mm max		
	MOUNTING SCREW TORQUE:		0.8N-m		
	DRAWN BY	DG	MENCOM CORPORATION TITLE: DB9 X 2; LP1		
	DRAWN DATE	12/06/2016			
	CHECKED BY				
	CHECK DATE				
	COMMENTS:		SIZE	DWG. NO.	REV
			B	LP1-2DB9	A
			SCALE: 2:3	WEIGHT:	SHEET 1 OF 1

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS
DRAWING IS THE SOLE PROPERTY OF
MENCOM CORPORATION. ANY
REPRODUCTION IN PART OR AS A WHOLE
WITHOUT THE WRITTEN PERMISSION OF
MENCOM CORPORATION IS
PROHIBITED.

UNLESS OTHERWISE SPECIFIED:

DIMENSIONS ARE IN INCHES
AND [MM]

	MATERIAL
--	----------

	FINISH
--	--------

DO NOT SCALE DRAWING